

QYI454F

THREE-PHASE SYNCHRONOUS GENERATOR

WINDING QY12 Datasheet for 4 poles -50Hz @ 1500rpm/ 60Hz @ 1800rpm

Ambient Temperature环境温度	40 ℃	Method of Cooling 冷却方式	Air cooling风冷
Temperature Rise 温升	125 ℃	Direction of Rotation 旋转方向	Clockwise顺时针
Insulation Class 绝缘等级	H	Maximum Over-speed 最高转速	2250r/min
Power Factor功率因数	0.8	Degree of Protection / Enclosure 防护等级	IP23
Excitation 励磁方式	Brushless无刷	Altitude 海拔	1000m
Winding Pitch 绕组节距	2/3	Stator winding 定子绕组	双层叠绕组 DLL
Pole极数	4	Number of Terminal 终端数量	6
Duty工作制	S1- Continuous	Rotor 转子	With damping cage带阻尼
Waveform 电话干扰因数	TIF<50		THF<2%
Waveform distortion 波形畸变率	BS EN 61000-6-2&BS EN 61000-6-4,VDE 0875G,VDE0874N		
Radio interference 无线电干扰	Noload<1.5%,Non-distorting balanced linear load<5%		
AVR MODEL AVR型号	Standard 标配	Selection 选配	PMG
	MX341B	MX321	MX341B MX321
Voltage Regulation - in steady state condition 电压调节	±0. 5	±0. 5	±0.5 ±0.5
Short Circuit Current Capacity 短路电流容量	6850A		

Electrical Characteristic									
Frequency频率	Hz	50				60			
Voltage (series star)电压 Y	V	380/220	400/231	415/240	440/254	416/240	440/254	460/266	480/277
Voltage (parallel star)电压 YY	V	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Voltage (series delta)电压 Δ	V	220	230	240	254	240	254	266	277
Rated power at Class H (125 °C) temperature rise	kVA	2020	2080	2080	2040	2345	2500	2550	2600
额定功率在H(125 °C)温升	kW	1616	1664	1664	1632	1876	2000	2040	2080
Efficiency at Class H (P.F.=0.8)绝缘等级H (P.F.=0.8)效率	4/4%	96.0	96	96.1	96.3	95.9	95.9	96	96.1
	3/4%	96.6	96.6	96.7	96.8	96.4	96.4	96.5	96.6
	2/4%	96.4	96.4	96.4	96.3	96.2	96.2	96.2	96.2
Efficiency at Class H (P.F.=1.0)绝缘等级H (P.F.=1.0)效率	4/4%	96.8	96.9	97	97.1	96.8	96.8	96.9	96.9
	3/4%	97.3	97.4	97.4	97.4	97.2	97.2	97.3	97.3
	2/4%	97.2	97.2	97.2	97.2	97	97	97	97
Reactances (%) at Class H 绝缘等级H考核时的电抗									
Direct axis synchronous reactance unsaturated 直轴同步电抗	Xd	2.93	2.73	2.53	2.21	3.55	3.38	3.16	2.96
Direct axis transient reactance saturated 直轴瞬态电抗	X'd	0.18	0.17	0.15	0.13	0.21	0.2	0.19	0.18
Direct axis subtransient reactance saturated 直轴瞬变电抗	X''d	0.13	0.12	0.11	0.1	0.16	0.15	0.14	0.13
Quadrature axis synchronous reactance unsaturated 交轴同步电抗	Xq	1.89	1.75	1.63	1.42	2.28	2.18	2.03	1.9
Quadrature axis subtransient reactance saturated 交轴起始瞬态电抗	X''q	0.26	0.25	0.23	0.2	0.32	0.31	0.29	0.27
Leakage reactance漏抗	Xl	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.03
Negative sequence reactance saturated 负序电抗饱和	X2	0.19	0.17	0.16	0.14	0.23	0.22	0.2	0.19
Zero sequence reactance unsaturated 零序电抗不饱和	X0	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02
Short-circuit ratio 短路比	Kcc	0.3413	0.3663	0.3953	0.4525	0.2817	0.2959	0.3165	0.3378

Short-circuit transient time constant (sec.)瞬变时间常数（秒）	T'd	0.154							
Subtransient time constant (sec.) 超瞬变时间常数（秒。）	T''d	0.02							
Open circuit time constant (sec.)开路时间常数	T'do	2.54							
Armature time constant (sec.)电枢时间常数	Ta	0.02							
Stator Winding Resistance (20℃)定子绕组电阻(20℃)	ohm	0.00076							
Rotor Winding Resistance (20℃)转子绕组电阻(20℃)	ohm	1.77							
Exciter Stator Resistance (20℃)励磁机定子电阻(20℃)	ohm	17.5							
Exciter Rotor Phase resistance 励磁机转子相电阻	ohm	0.063							
No load excitation current空载励磁电流	io (A)	0.6	0.63	0.71	0.65	0.56	0.6	0.62	0.63
Full load excitation current满载励磁电流	ic(A)	3.2	3.2	3.6	3.2	3.4	3.3	3.4	3.5
Cooling air requirement空气冷却要求	m³/sec	2.69m3/s 5200cfm				3.45m3/s 7300cfm			

Mechanical Characteristic		
Configuration 结构	Single Bearing 单轴承	Double Bearing 双轴承
Type of Construction 结构形式	B2-SAE	IM B34
Total Weight - kgs 总重量-公斤	3830	3800
Weight wound stator - kgs 定子重量-公斤	1905	1905
Weight wound rotor - kgs 转子重量-公斤	1609	1565
Inertia (J) [kgm2] 转动惯量 (J) [kgm2)	49.3409kgm2	48.424kgm2
Drive end bearing / Lubrication 驱动端轴承/润滑		BALL.6228-2RS(ISO)
Non-drive end bearing / Lubrication非驱动端轴承/润滑	BALL.6319-2RS(ISO)	BALL.6319-2RS(ISO)
Packing crate size 包装尺寸（cm）	220X101X159	230X101X159

QYI454F


Winding 312 / 0.8 Power Factor

RATINGS

Class - Temp Rise		Cont. F - 105/40°C				Cont. H - 125/40°C				Standby - 150/40°C				Standby - 163/27°C			
50Hz	Star (V)	380	400	415	440	380	400	415	440	380	400	415	440	380	400	415	440
	kVA	1880	1935	1935	1900	2020	2080	2080	2040	2105	2170	2170	2125	2165	2250	2250	2185
	kW	1504	1548	1548	1520	1616	1664	1664	1632	1684	1736	1736	1700	1732	1800	1800	1748
	Efficiency (%)	96.1	96.2	96.3	96.4	96.0	96.0	96.1	96.3	95.9	95.9	96.0	96.2	95.8	95.8	96.0	96.2
	kW Input	1565	1609	1607	1577	1683	1733	1732	1695	1756	1810	1808	1767	1808	1878	1876	1817

60Hz	Star (V)	416	440	460	480	416	440	460	480	416	440	460	480	416	440	460	480
	kVA	2190	2325	2370	2420	2345	2500	2550	2600	2435	2600	2650	2705	2505	2675	2730	2785
	kW	1752	1860	1896	1936	1876	2000	2040	2080	1948	2080	2120	2164	2004	2140	2184	2228
	Efficiency (%)	96.0	96.1	96.1	96.2	95.9	95.9	96.0	96.1	95.8	95.8	95.9	96.0	95.7	95.8	95.9	95.9
	kW Input	1825	1935	1973	2012	1957	2086	2125	2164	2033	2171	2211	2254	2094	2234	2277	2323

DIMENSIONS




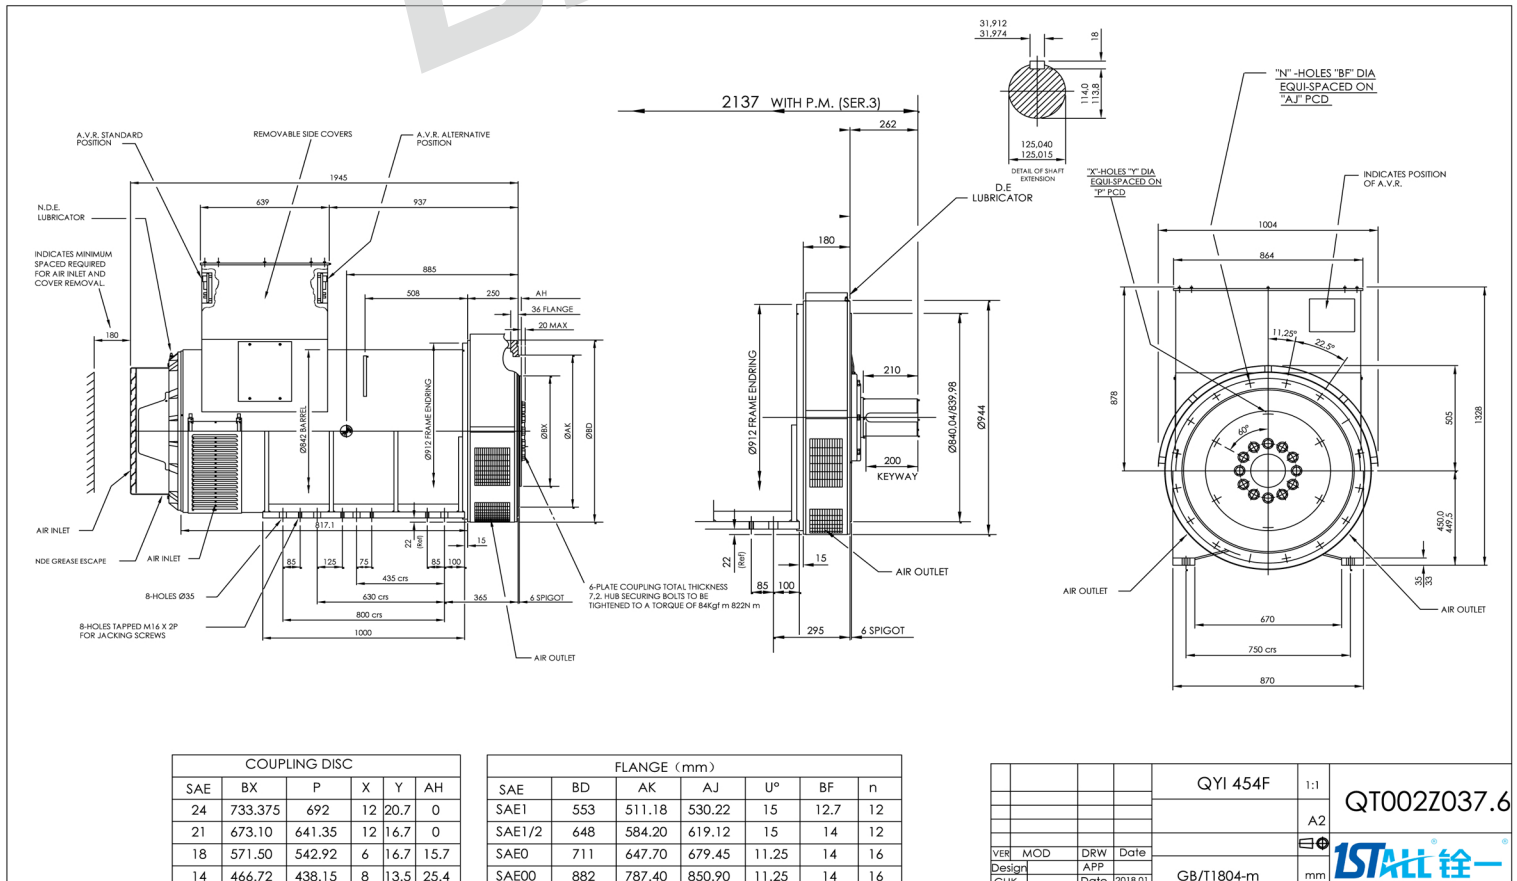


50
Hz

QYI314F

Winding 311





THREE PHASE EFFICIENCY CURVES

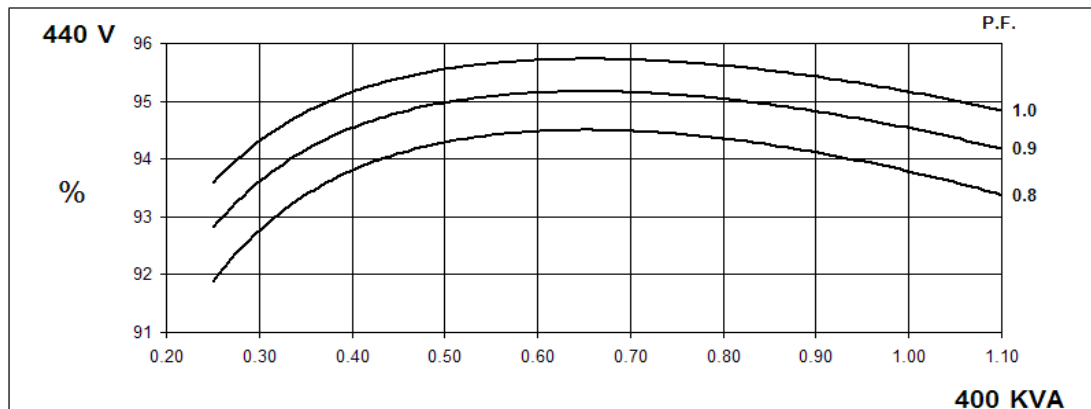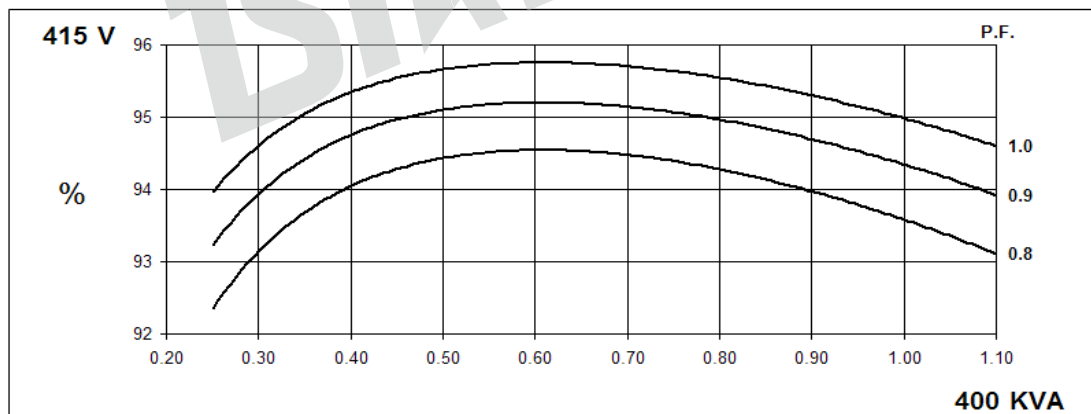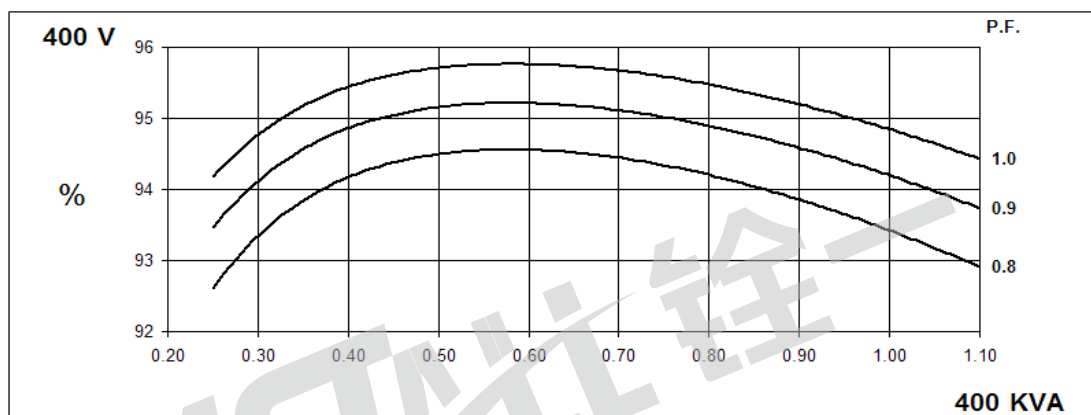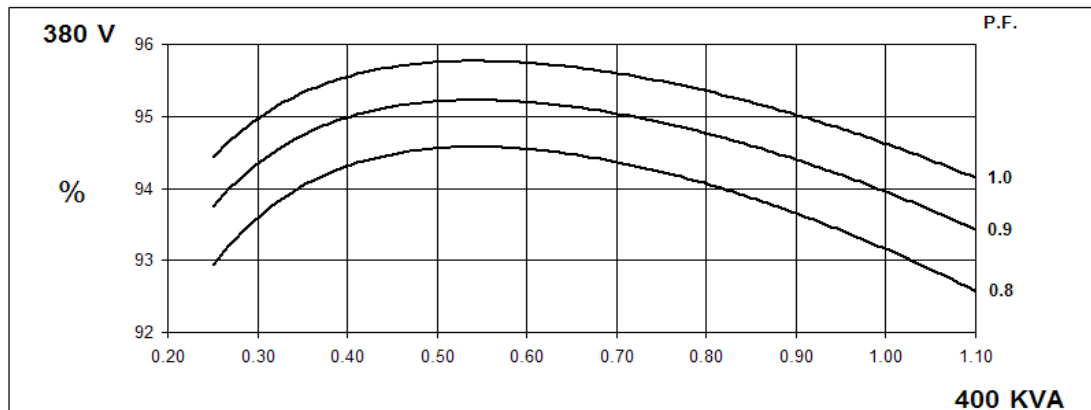

60
Hz

QYI314F
Winding 311


THREE PHASE EFFICIENCY CURVES

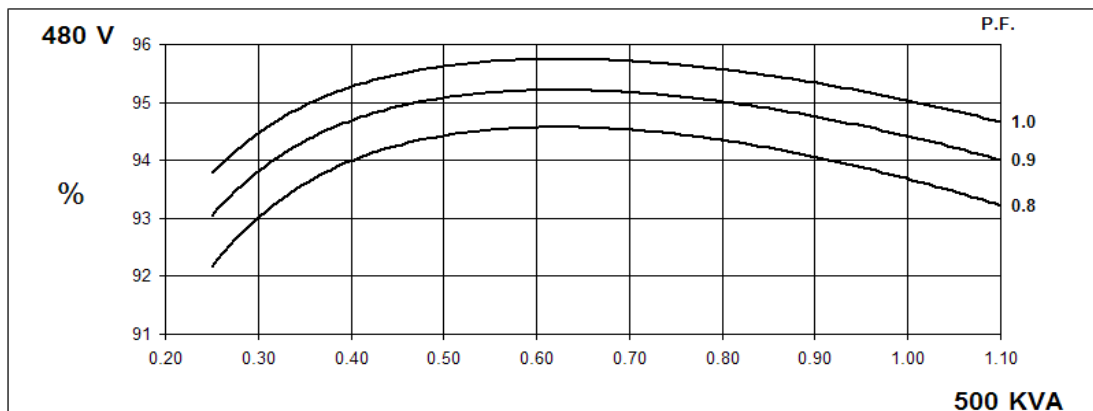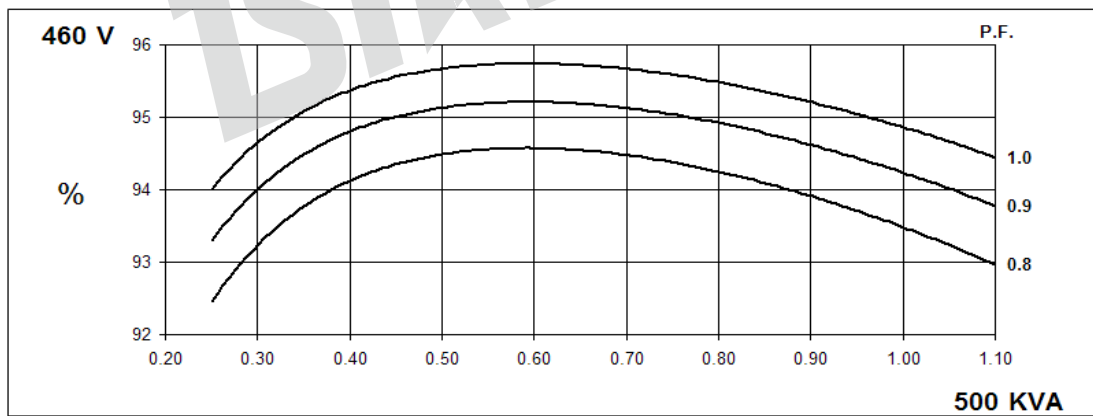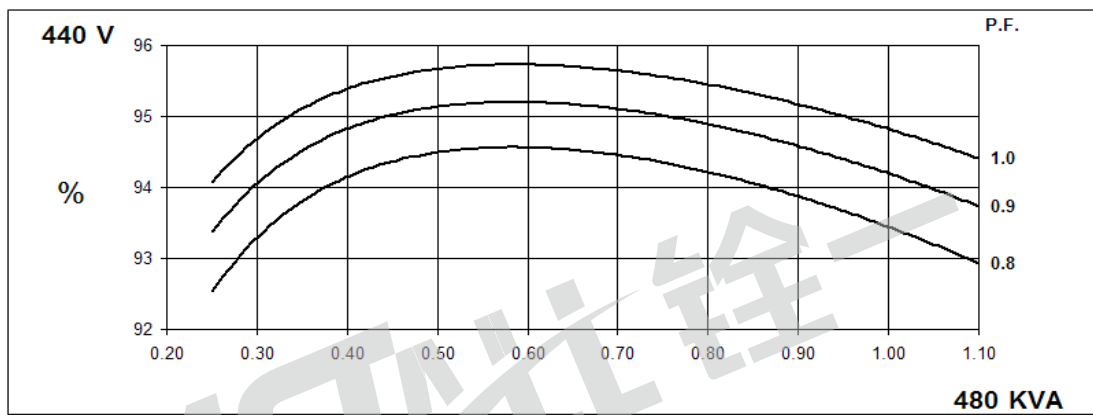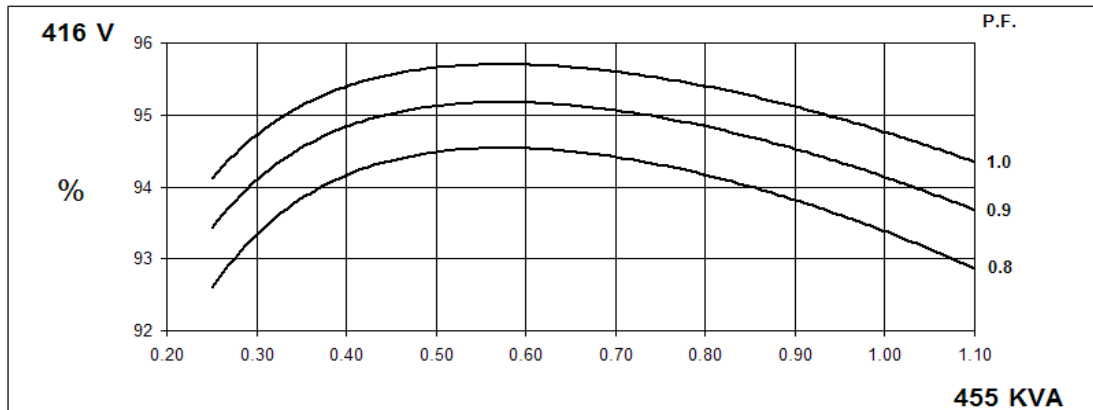

QYI314F


Three-phase Short Circuit Decrement Curve. No-load Excitation at Rated Speed Based on star (wye) connection.

50
Hz

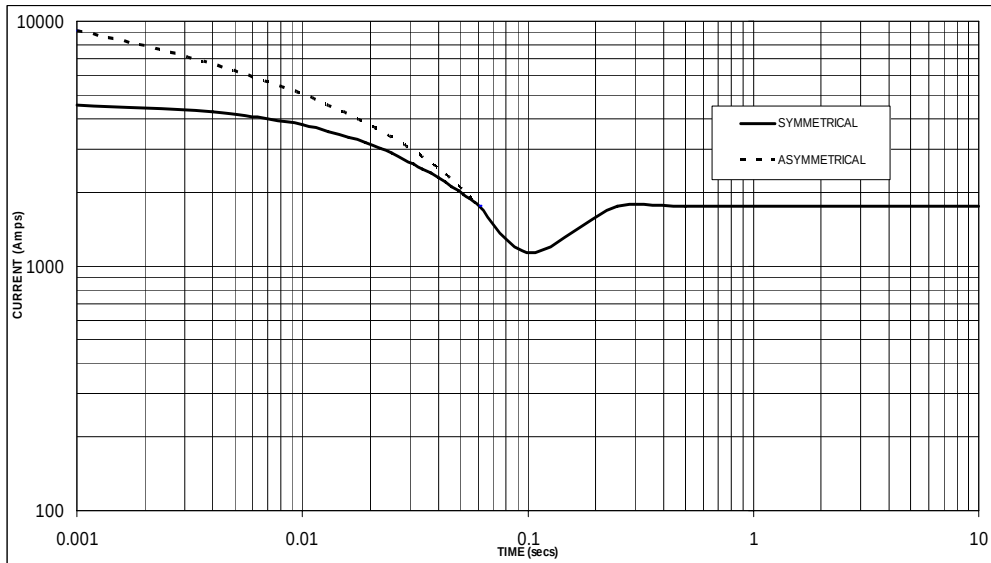

Sustained Short Circuit = 1,750 Amps

60
Hz

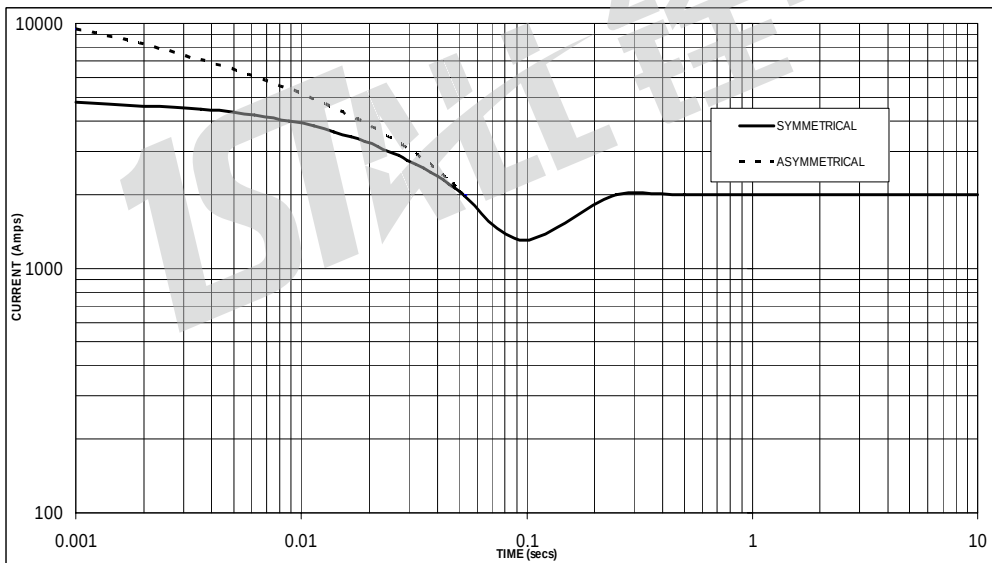

Sustained Short Circuit = 2,000 Amps

Note 1

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
380v	X 1.00	416v	X 1.00
400v	X 1.05	440v	X 1.06
415v	X 1.09	460v	X 1.10
440v	X 1.16	480v	X 1.15

The sustained current value is constant irrespective of voltage level

Note 2

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	x 1.00	x 1.50	x 2.50
Max. sustained duration	10 sec.	5 sec.	2 sec.

Note 3

All other times are unchanged

Curves are drawn for Star (Wye) connected machines. For other connection the following multipliers should be applied to current values as shown :

Parallel Star = Curve current value X 2

